

**ADDENDUM**

Addendum No.   1  

Owner:   City of Owosso    
Project:   Backwash VFD Voltage Protection Bid    
Engineer:   OHM Advisors  

**NOTICE TO ALL PROSPECTIVE BIDDERS**

BIDS DUE   March 21, 2023  

=====

This Addendum is a part of the Contract Documents and modifies the previously issued Bidding Documents. Acknowledge receipt of this Addendum in the space provided on the *Signature Page and Legal Status* section of the Bid Proposal. Failure to do so may result in rejection of the Bid.

ITEM NO. 1:

NOTICE TO BIDDERS -

**Delete :**

Bids will be accepted until **3:00 p.m., March 23, 2023**, for the **Backwash VFD Voltage Protection**, at which time bids will be publicly opened and read aloud.

**Change to:**

Bids will be accepted until **3:00 p.m. March 21, 2023**, for the Backwash VFD Voltage Protection, at which time bids will be publicly opened and read aloud.

ITEM NO 2:

**Delete** Schematic Drawing found in Bid Document "Backwash VFD Voltage Protection."

**Add** Schematic Drawing attached to this Addendum No. 1

**I acknowledge receipt of Addendum No. 1**

(PLEASE TYPE OR PRINT BELOW)

LEGAL NAME OF BIDDER: \_\_\_\_\_

MAILING ADDRESS: \_\_\_\_\_

CITY, STATE, ZIP: \_\_\_\_\_

TELEPHONE NUMBER \_\_\_\_\_ EMAIL I.D. \_\_\_\_\_ FAX # \_\_\_\_\_


BY: SIGNATURE: \_\_\_\_\_

OF AUTHORIZED REPRESENTATIVE

NAME (typed/printed) \_\_\_\_\_ TITLE: \_\_\_\_\_

**END OF ADDENDUM NO. 1**

DRAWING PATH: C:\Users\SDarous\AppData\Local\Temp\AcPublish\_12886\OneLine.DWG Feb 23, 2023 - 2:35pm

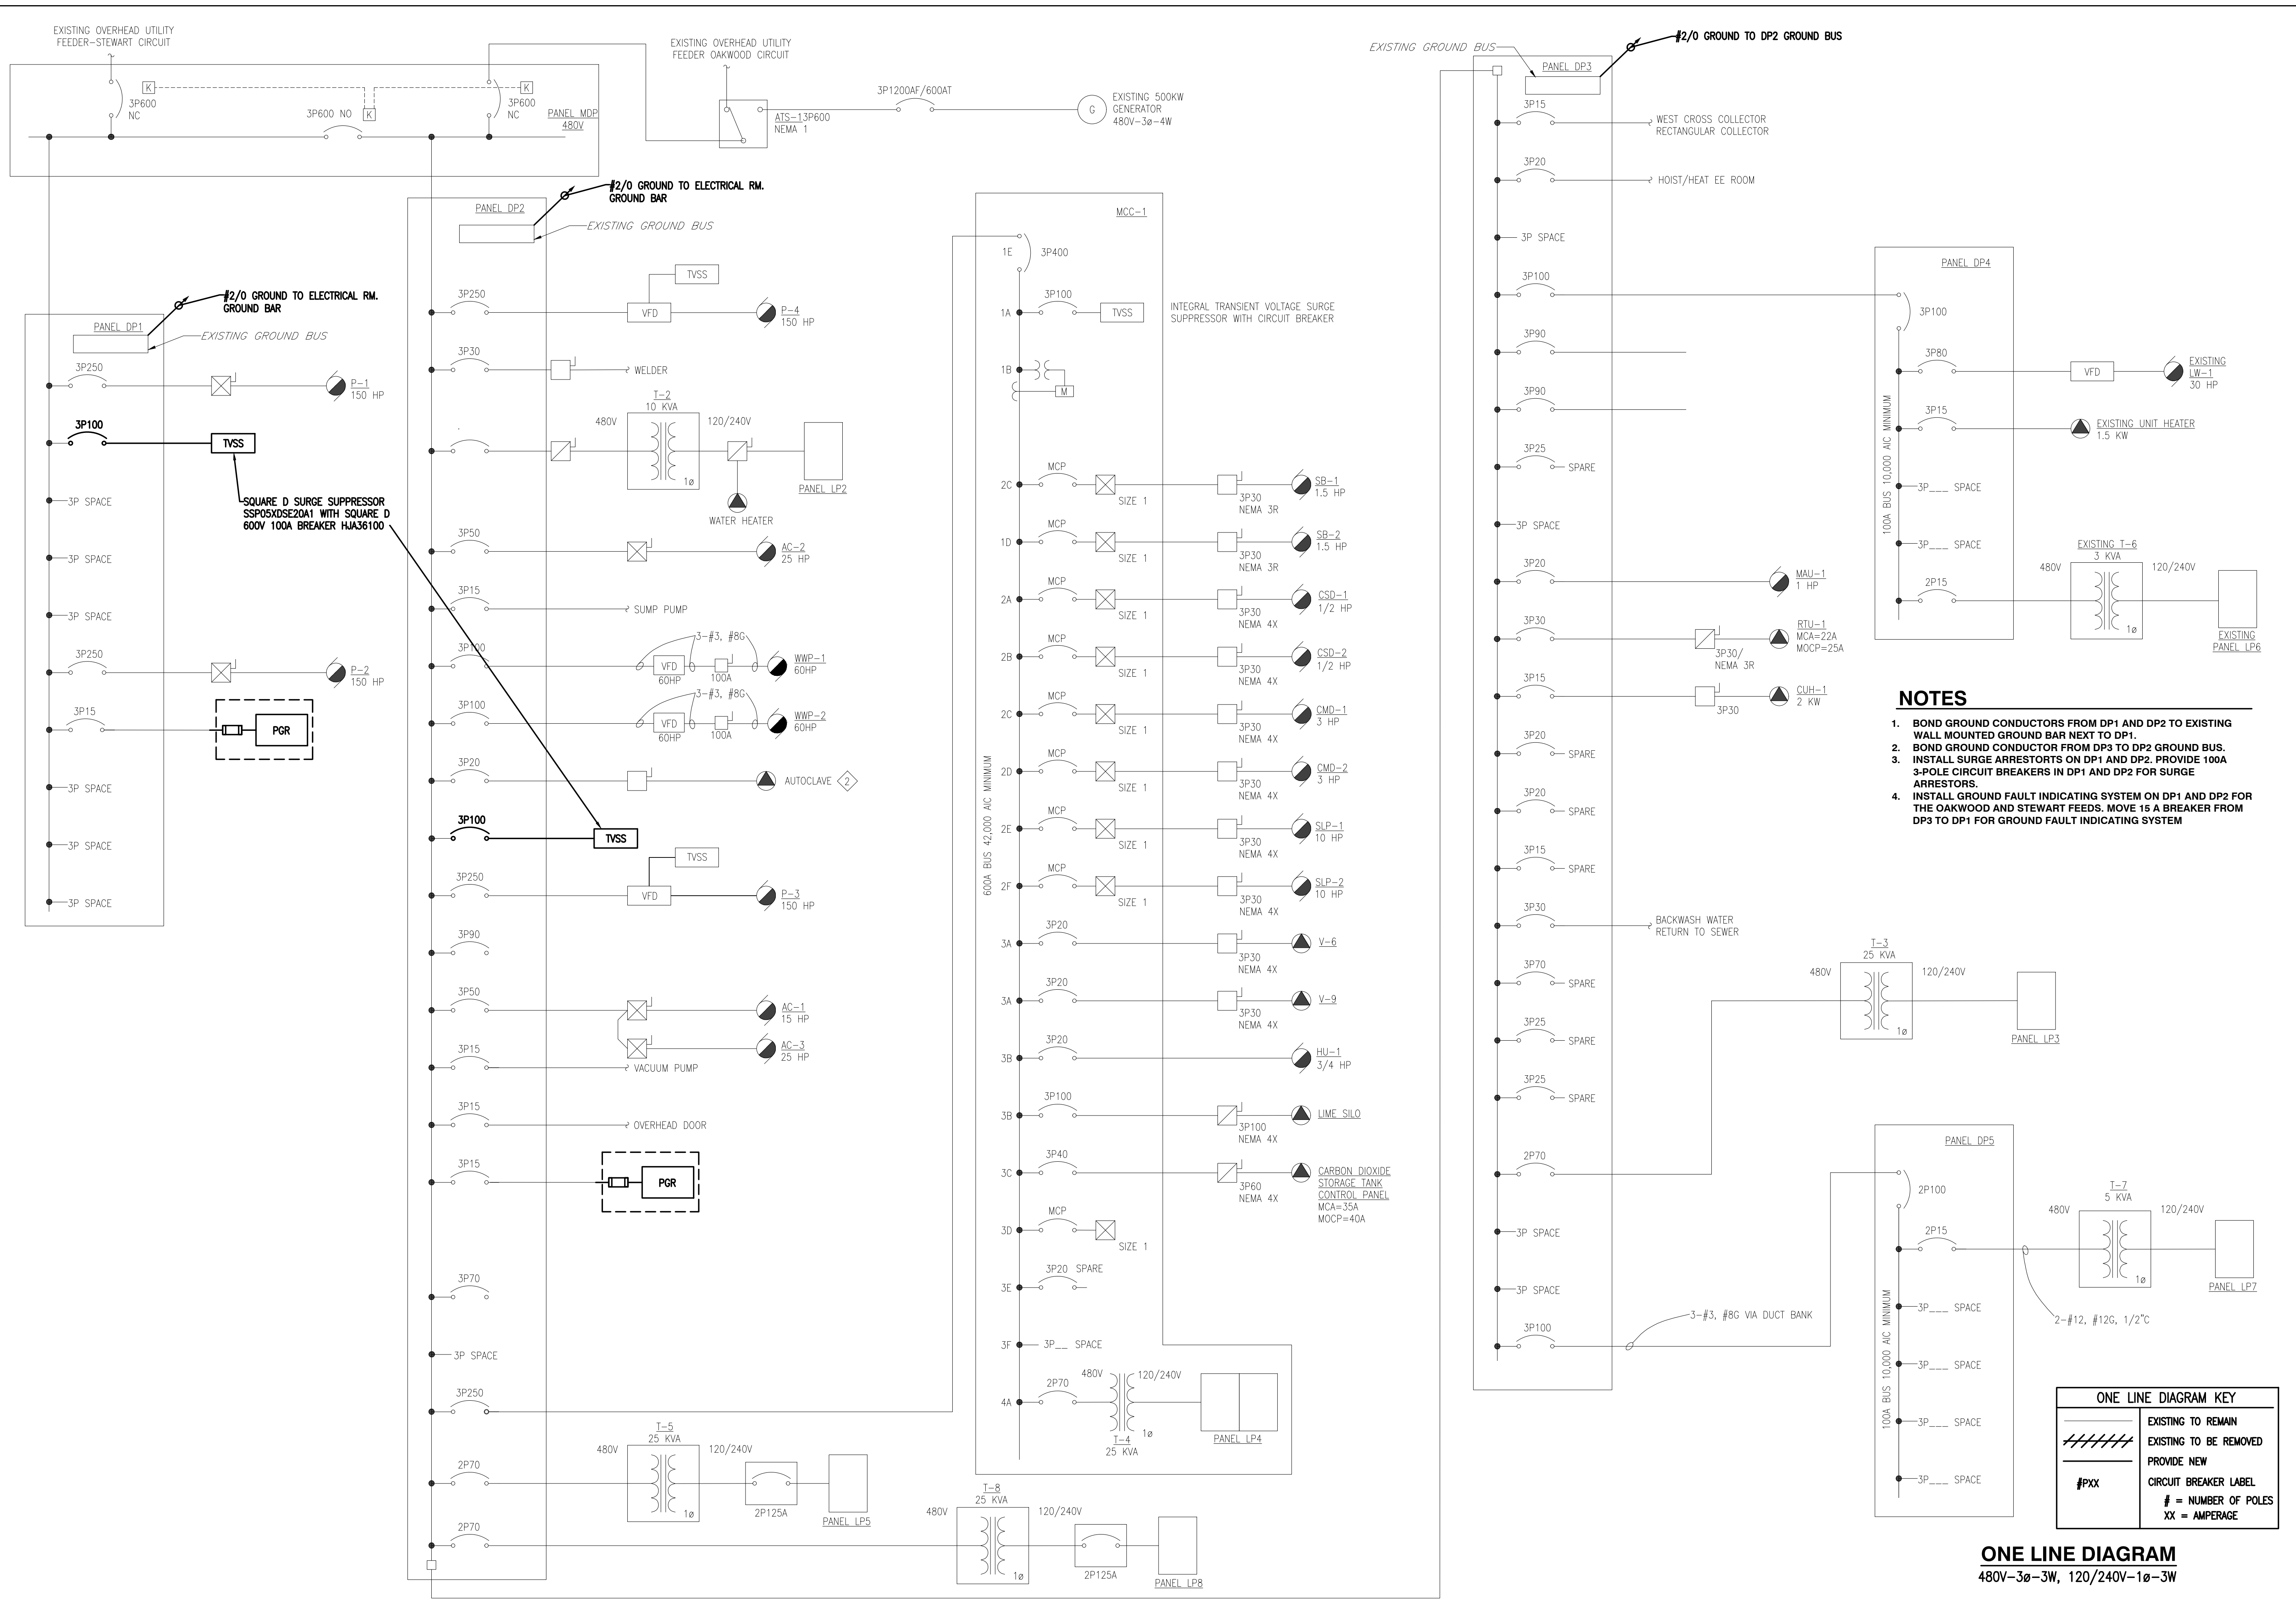


- NOTES**
- BOND GROUND CONDUCTORS FROM DP1 AND DP2 TO EXISTING WALL MOUNTED GROUND BAR NEXT TO DP1.
  - BOND GROUND CONDUCTOR FROM DP3 TO DP2 GROUND BUS.
  - INSTALL SURGE ARRESTORS ON DP1 AND DP2. PROVIDE 100A 3-POLE CIRCUIT BREAKERS IN DP1 AND DP2 FOR SURGE ARRESTORS.
  - INSTALL GROUND FAULT INDICATING SYSTEM ON DP1 AND DP2 FOR THE OAKWOOD AND STEWART FEEDS. MOVE 15A BREAKER FROM DP3 TO DP1 FOR GROUND FAULT INDICATING SYSTEM

**ONE LINE DIAGRAM KEY**

//////	EXISTING TO REMAIN
-----	EXISTING TO BE REMOVED
-----	PROVIDE NEW
#PXX	CIRCUIT BREAKER LABEL
#	= NUMBER OF POLES
XX	= AMPERAGE

**ONE LINE DIAGRAM**  
480V-3ø-3W, 120/240V-1ø-3W



**OHM**  
ARCHITECTS ENGINEERS PLANNERS  
34000 Plymouth Road  
Livonia, MI 48150  
P (734) 522-6711 | F (734) 522-6427  
OHM-ADVISORS.COM

---

REVISIONS:

DATE	PROJ. NUMBER	ENG.	PROJ. MGR.	CITY/VILLAGE/TOWNSHIP	COUNTY	SCALE	H.	NTS	V.	NTS
02/23/2023	002020100	TC	SD							

---

**BACKWASH VFD Protection ONE-LINE DIAGRAM**

---

**E-501**

COPYRIGHT 2016 OHM ALL DRAWINGS AND WRITTEN MATERIALS APPEARING HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK OF OHM AND THE SAME MAY NOT BE DUPLICATED, DISTRIBUTED, OR DISCLOSED WITHOUT PRIOR WRITTEN CONSENT OF OHM